


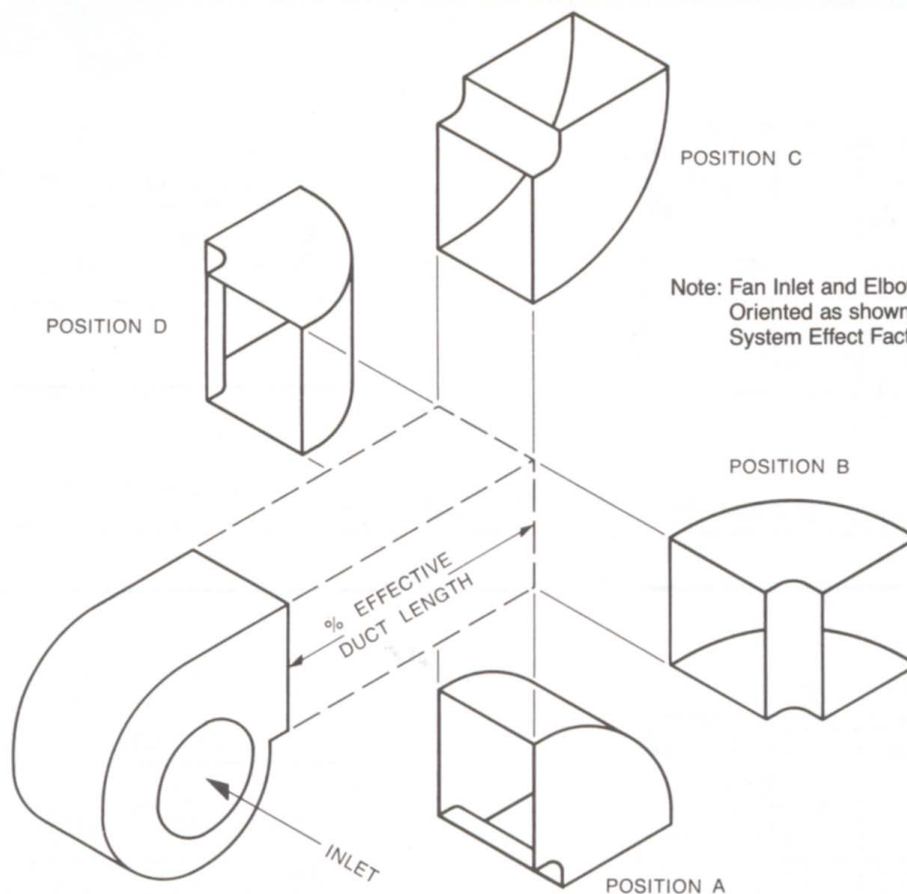

Blast Area Outlet Area	Outlet Elbow Position	No Outlet Duct	12% Effective Duct	25% Effective Duct	50% Effective Duct	100% Effective Duct
0.4	A	3.2	2.5	1.8	0.8	N O S Y S T E M E F F E C T I V E F A C T O R
	B	4.6	3.9	2.5	1.2	
	C	5.5	4.6	3.2	1.6	
	D	5.5	4.6	3.2	1.6	
0.5	A	2.0	1.6	1.2	0.53	
	B	2.9	2.3	1.8	0.80	
	C	3.9	2.9	2.3	1.0	
	D	3.9	2.9	2.3	1.0	
0.6	A	1.6	1.4	1.0	0.40	
	B	2.0	1.6	1.2	0.53	
	C	2.9	2.3	1.8	0.80	
	D	2.5	2.0	1.4	0.66	
0.7	A	0.66	0.53	0.40	0.18	
	B	1.0	0.80	0.53	0.26	
	C	1.4	1.2	0.80	0.33	
	D	1.2	1.0	0.66	0.33	
0.8	A	0.8	0.66	0.47	0.22	
	B	1.2	1.0	0.66	0.33	
	C	1.6	1.4	1.0	0.40	
	D	1.4	1.2	0.8	0.33	
0.9	A	0.66	0.53	0.40	0.18	
	B	1.0	0.80	0.53	0.26	
	C	1.2	1.0	0.66	0.33	
	D	1.0	0.80	0.53	0.26	
1.0	A	1.0	0.80	0.53	0.26	
	B	0.66	0.53	0.40	0.18	
	C	1.0	0.80	0.53	0.26	
	D	1.0	0.80	0.53	0.26	

AMERICAN CONFERENCE
OF GOVERNMENTAL
INDUSTRIAL HYGIENISTS

SYSTEM EFFECT FACTORS
FOR OUTLET ELBOWS
(Adapted from AMCA 201)

DATE

1-88

FIGURE

6-17